

CLASS.NO.	TITLE
	TACT SWITCH SPECIFICATION

1. GENERAL

1.1 Scope This specification covers the requirements for single key switches which have no keytop (TACT SWITCHES: MECHANICAL CONTACT).

1.2 Operating Temperature Range -20 to 70°C (normal humidity, normal press.)

1.3 Storage Temperature Range -30 to 80°C (normal humidity, normal press.)

1.4 Test Conditions *However, 96 hours maximum for continuous storage over a range -20°C ~ -30°C and a range 70°C ~ 80°C.* Tests and measurements shall be made in the following standard conditions unless otherwise specified:

- Normal temperature (temperature 5 to 35°C)
 - Normal humidity (relative humidity 45 to 85%)
 - Normal pressure (pressure 860 to 1060 m bars)
- In case any question arises from the judgement made, tests shall be conducted in the following conditions:
- Temperature (20±2°C)
 - Relative humidity (65±5%)
 - Pressure (860 to 1060 m bars)

2. APPEARANCE, STYLE, AND DIMENSIONS


2.1 Appearance There shall be no defects that affect the serviceability of the product.

2.2 Style and Dimensions Shall conform to the assembly drawings.

3. TYPE OF ACTUATION Tactile feedback

4. CONTACT ARRANGEMENT 1 poles 1 throws
(Details of contact arrangement are given in the assembly drawings.)


5. MAXIMUM RATINGS DC 12 V 50 mA

						 ALPS ELECTRIC CO., LTD.			
						APPD.	CHKD.	DSGD.	SPECIFICATION
						4/12/89	4/12/89	Apr. 7-89	
5/6	Δ-1	20420	<i>[Signature]</i>	<i>[Signature]</i>	<i>[Signature]</i>	<i>[Signature]</i>	<i>[Signature]</i>	<i>[Signature]</i>	DOCUMENT NO.
PAGE	SYMB.	DATE	APPD.	CHKD.	DSGD.				KHH-914 (1/6)

CLASS.NO.	TITLE	
	TACT SWITCH SPECIFICATION	

6. PERFORMANCE

6.1 Electrical

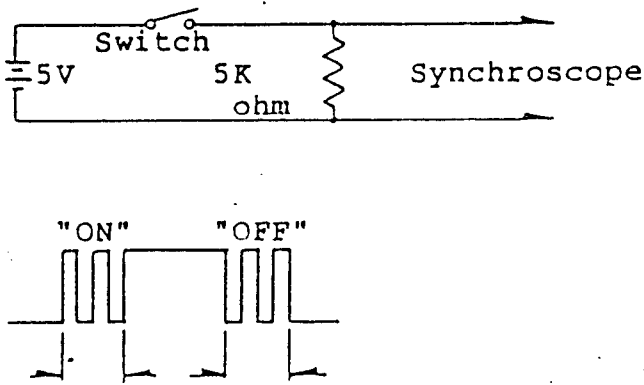
Item	Test Conditions	Requirements
6.1.1. Contact Resistance	Applying a static load twice the actuating force to the center of the stem, measurements shall be made with a 1 kHz small-current contact resistance meter.	<u>100</u> m ohm max.
6.1.2. Insulation Resistance	Measurements shall be made following application of DC <u>100V</u> potential across terminals and across terminals and frame for one minute.	<u>100</u> M ohm min.
6.1.3. Dielectric With-standing Volatge	AC <u>250 V</u> (50Hz or 60Hz) shall be applied across terminals and across terminals and frame for one minute.	There shall be no breakdown.
6.1.4. Bounce	Lightly striking the center of the stem at a rate encountered in normal use (3 to 4 operations per sec.), bounce shall be tested at "ON" and "OFF". 	<u>5</u> m sec max.

						ALPS ELECTRIC CO., LTD.			
						APPD.	CHKD.	DSGD.	SPECIFICATION
						4/12/89	4/12/89	Apr. 17-89	
PAGE	SYMB.	DATE	APPD.	CHKD.	DSGD.	DOCUMENT NO.			(2/6)
						KHH-914			

CLASS.NO.	TITLE
	TACT SWITCH SPECIFICATION


6.2 Mechanical

Item	Test Conditions	Requirements
6.2.1 Actuating Force	Placing the switch such that the direction of switch operation is vertical and then gradually increasing the load applied to the center of the stem, the maximum load required for the stem to come to a stop shall be measured.	<u>160</u> + <u>50</u> gf
6.2.2 Travel	Placing the switch such that the direction of switch operation is vertical and then applying a static load twice the actuating force to the center of the stem, the travel distance for the stem to come to a stop shall be measured.	0.2 <u>0.25</u> + <u>0.1</u> mm
6.2.3 Return Force	The sample switch is installed such that the direction of switch operation is vertical and, upon depression of the stem in its center the whole travel distance, the force of the stem to return to its free position shall be measured.	<u>50</u> gf min.
6.2.4 Stop Strength	Placing the switch such that the direction of switch operation is vertical, a static load of <u>3</u> kgf shall be applied in the direction of stem operation for a period of <u>60</u> seconds.	There shall be no sign of damage mechanically and electrically.
6.2.5 Stem Strength	Placing the switch such that the direction of switch operation is vertical, the maximum force to withstand a pull applied opposite to the direction of stem operation shall be measured.	<u>3</u> kgf

 ALPS ELECTRIC CO., LTD.							
				APPD.	CHKD.	DSGD.	SPECIFICATION
				<i>4/12/89</i>	<i>4/12/89</i>	<i>Apr. 17. 89</i>	
PAGE	SYMB.	DATE	APPD.	CHKD.	DSGD.	DOCUMENT NO.	KHH-914 (3/6)

CLASS.NO.	TITLE
	TACT SWITCH SPECIFICATION

6.3 Environmental

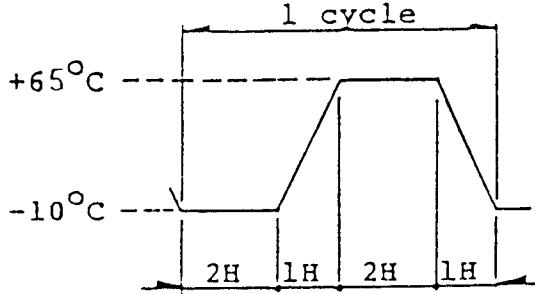Item	Test Conditions	Requirements
6.3.1 Resistance to Low Temperatures	Following the test set forth below the sample shall be left in normal temperature and humidity conditions for one hour before measurements are made: (1) Temperature: $-30 \pm 2^{\circ}\text{C}$ (2) Time: 96 hours (3) Waterdrops shall be removed.	Item 6.1 Item 6.2.1 Item 6.2.2
6.3.2 Heat Resistance	Following the test set forth below the sample shall be left in normal temperature and humidity conditions for one hour before measurements are made: (1) Temperature: $80 \pm 2^{\circ}\text{C}$ (2) Time: 96 hours	Item 6.1 Item 6.2.1 Item 6.2.2
6.3.3 Moisture Resistance	Following the test set forth below the sample shall be left in normal temperature and humidity conditions for one hour before measurements are made: (1) Temperature: $60 \pm 2^{\circ}\text{C}$ (2) Relative humidity: 90 to 95% (3) Time: 96 hours (4) Waterdrops shall be removed.	Contact resistance: <u>200</u> m ohm max. Insulation resistance: <u>10</u> M ohm min. Item 6.1.3 Item 6.1.4 Item 6.2.1 Item 6.2.2
6.3.4 Temperature Cycling	Following five cycles of the temperature cycling test set forth below the sample shall be left in normal temperature and humidity conditions for one hour before measurements are made. During this test, waterdrops shall be removed. 	Item 6.1 Item 6.2.1 Item 6.2.2

ALPS ELECTRIC CO., LTD.								
				APPD.	CHKD.	DSGD.	SPECIFICATION	
				4/12/89	4/12/89	Apr. 11-89	DOCUMENT NO.	
PAGE	SYMB.	DATE	APPD.	CHKD.	DSGD.		KHH-914 (4/6)	

CLASS.NO.	TITLE	
	TACT SWITCH SPECIFICATION	

***** Switch Handling Precautions*****


1. In case an automatic flow soldering apparatus is used for soldering, adhere to the following conditions:

Item	Soldering condition
(1)Preheat Temperature	100°C max. (Ambient temperature of printed circuit board on its soldering side)
(2)Preheat Time	45 sec. max.
(3)Flux Foaming	To such an extent that flux will be kept flush with the printed circuit board's top surface on which components are mounted. Preparatory flux must not be applied to that side of printed circuit board on which components are mounted and to the area where terminals are located.
(4)Soldering Temperature	255°C max.
(5)Duration of Solder Immersion	5 sec. max.
(6)Allowable Frequency of Soldering Process	1 time




2. Other Precautions

- (1) Following the soldering process, do not try to clean the switch with a solvent or the like.
- (2) Safeguard the switch assembly against flux penetration from its top side.

(3) Flux . Specific Gravity = 0.82 ~ 0.84


						 ALPS ELECTRIC CO., LTD.			
						APPD.	CHKD.	DSGD.	SPECIFICATION
						4/12/89	4/12/89	Apr 7-89	
PAGE	SYMB.	DATE	APPD.	CHKD.	DSGD.	<i>Suzuki</i>	<i>H. Kobayashi</i>	<i>T. Kobayashi</i>	DOCUMENT NO.
									KHH-914 (6/6)

TERMINAL

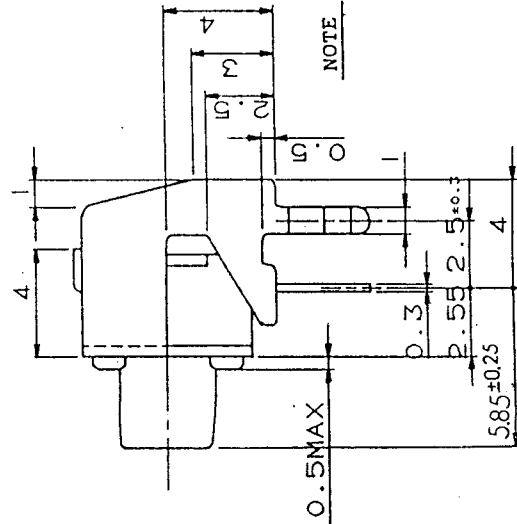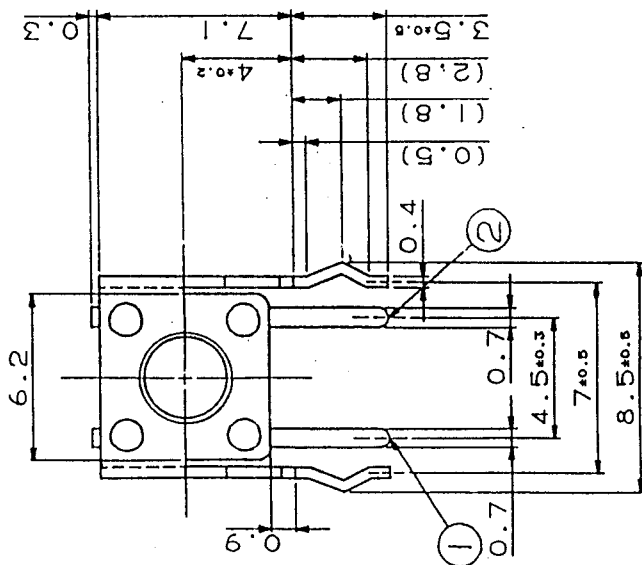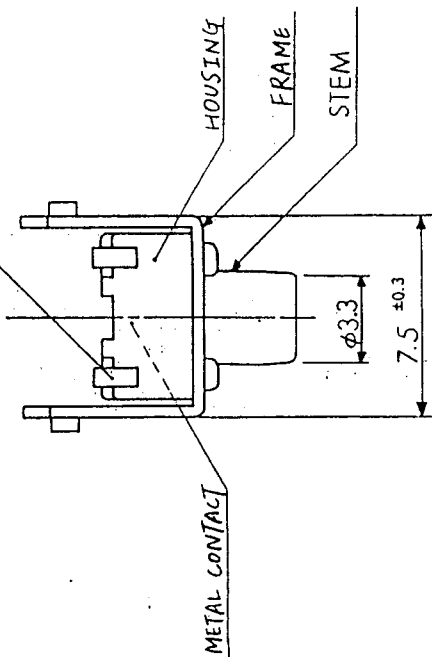


NOTE

PRINTED CIRCUIT BOARD MOUNTING HOLE DIMENSIONS
(WHEN VIEWED FROM SWITCH MOUNTING FACE)

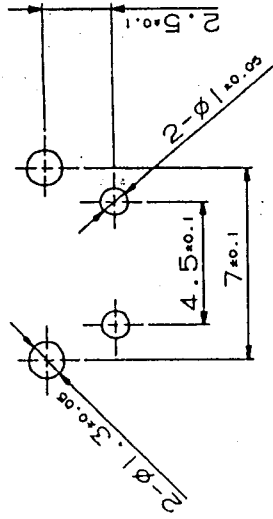

CIRCUIT DIAGRAM



1. MANUFACTURING SPECIFICATION TO BE ACCORDANCE WITH

KHH-914.

2. STEM COLOR TO BE DARK GRAY.

3. THE RECOMMENDABLE THICKNESS OF A P.W. BOARD SHALL

BE 1.6mm

TOLEANCES UNLESS OTHERWISE SPEC.
BASIC DIMENSIONS TOLERANCES

UP TO 10	± 0.3
ABOVE 10 TO 100	± 0.5
ABOVE 100	± 0.8
EVERY IN DIMENSIONS	+ 0.3

PART NO.	NAME	MATERIAL	SPEC	FINISH
		ALPS	ALPS ELECTRIC CO., LTD.	
		UNIT	SCALE	
		mm	5:1	SKHHLV
		CHKD.	DSGD.	TITLE
		APPD.	Apr. 15 '86	TACT SWITCH
				DOCUMENT NO.
				K Kagawa
				9(16)